


	EN	FI	SE	DE	5P DALI	5P ON-OFF	3P ON-OFF
L	BN BROWN	RU	BR	BR	1 L	L	L
N	BU BLUE	SI	BL	BL	2 N	N	N
PE	GN-YE GREEN-YELLOW	KE-VI	GR-GU	GN-GE	⊕ PE	PE	PE
DA+	WH WHITE	VA	VT	WS	2 DA+	L2	
DA-	BK BLACK	MU	SV	SW	3 DA-	L3	

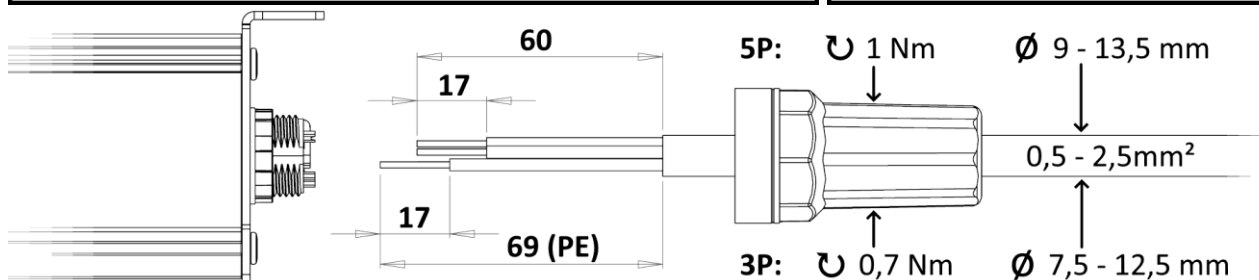


EN: Control circuit must be provided with cable which is insulated according to the mains voltage.

FI: Ohjauspiirissä on käytettävä verkkojännitteen mukaan eristettyjä johtimia.

SE: Styrkrets måste ha kabel som är isolerad enligt nätspänningen.

DE: Der Steuerkreis muss mit einem Kabel versehen sein, die entsprechend der Netzspannung isoliert ist.



	B10 A	B16 A	C10 A	C16 A
PICA 1-40	21	34	35	56
PICA 1-80	11	18	19	30
PICA 2-100	8	13	14	21
PICA 2-150	6	10	11	17
PICA 3-200	4	6	7	11

<b>Inrush current peak</b>		<b>Earth leakage current</b>
PICA 1-40	25A, t = 177µs (50 % of Ipeak)	< 0,5 mA
PICA 1-80	42A, t = 186µs (50 % of Ipeak)	< 0,4 mA
PICA 2-100	46A, t = 240µs (50 % of Ipeak)	< 0,4 mA
PICA 2-150	52A, t = 308µs (50 % of Ipeak)	< 0,5 mA
PICA 3-200	2 x [46A, t = 240µs] (50 % of Ipeak)	< 0,8 mA